Frequency of Water Restrictions for the 1965 − 2000 Simulation Period

Lake Okeechobee Service Area − T3exSSM

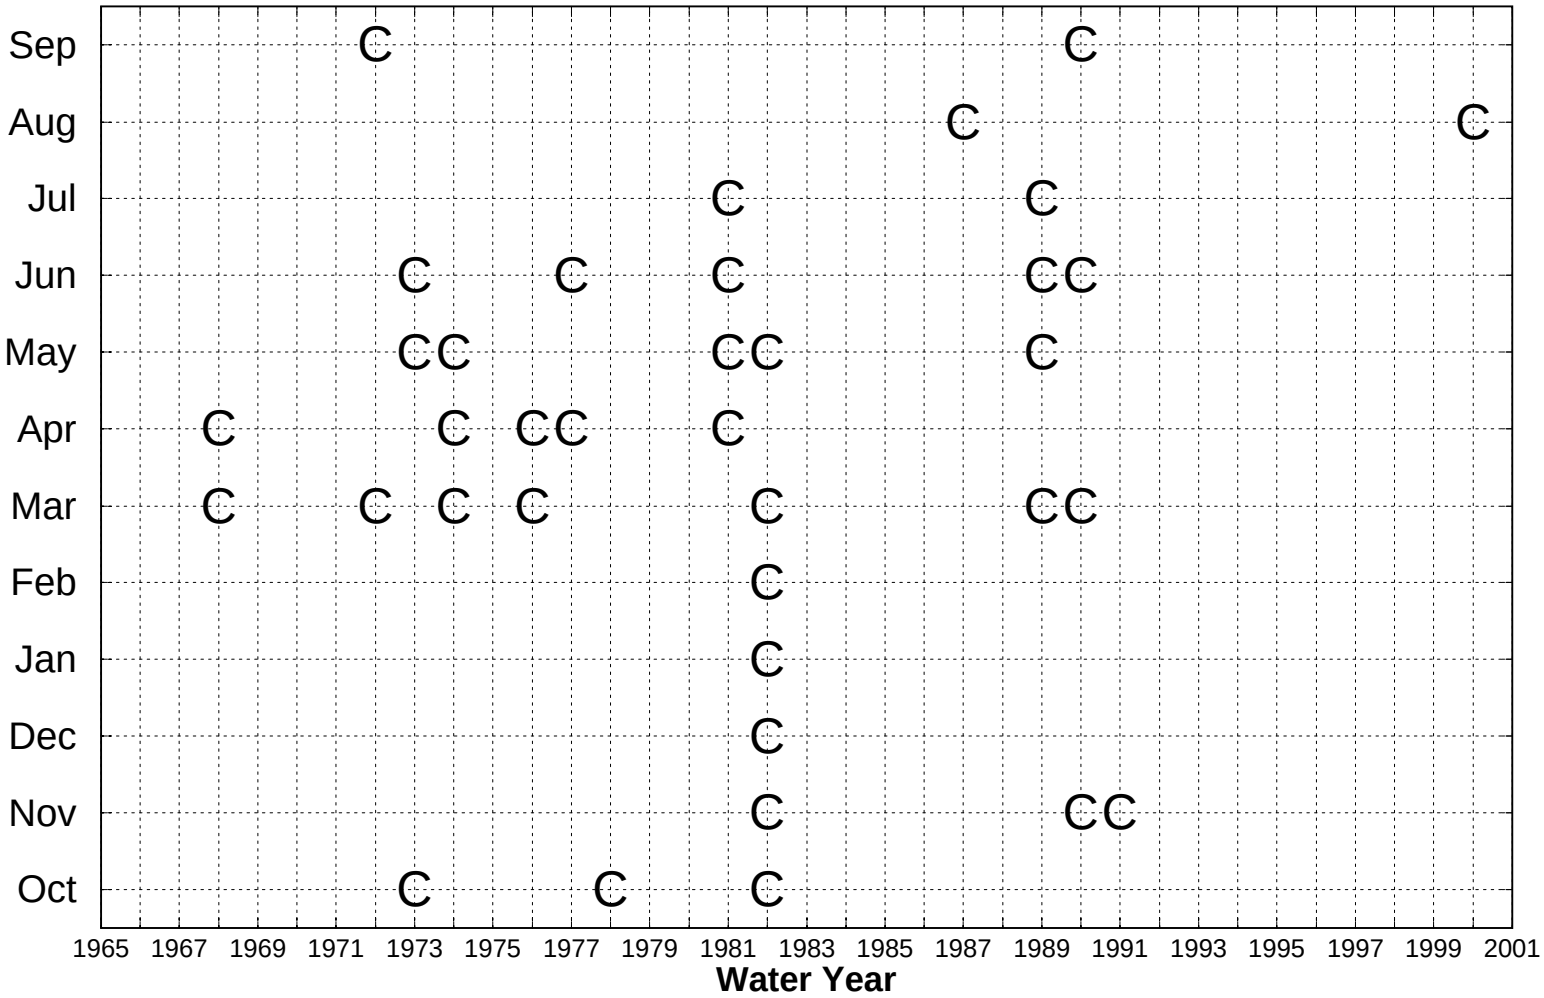

Total number of water years with restrictions=14

Target number of water years with restrictions=8

C: Under Supply Side Management and Cutbacks for 7 days or more, and Cutbacks greater or equal than 10% and 18000 ac−ft/month

Note: Water year 1981 starts Oct/1980 and ends Sep/1981

For Planning Purposes Only
Run date: 02/09/07 13:47:01
SFWMM V5.5.2
Script used: freq_water_restr.scr, V1.11
Filename: losa_freq_restr.T3exSSM.fig