


Frequency of Water Restrictions for the 1965 – 2000 Simulation Period

Lake Okeechobee Service Area – alt2b

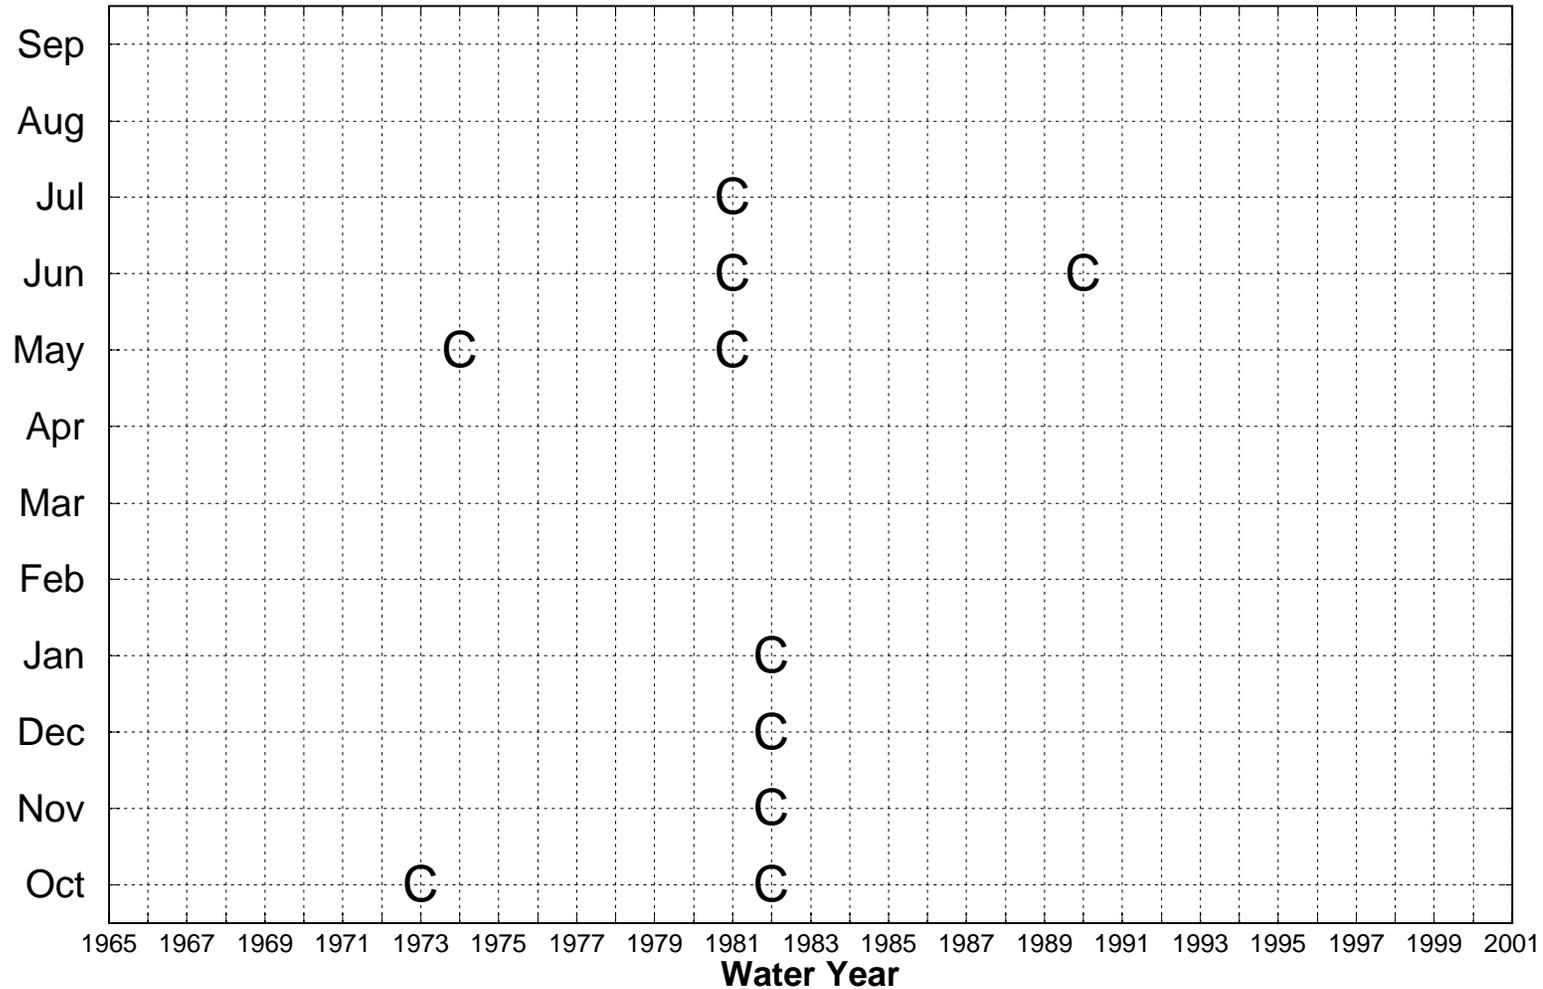

Total number of water years with restrictions 5

Target number of water years with restrictions 5

C: Under Supply Side Management and Cutbacks for 7 days or more, and Cutbacks greater or equal than 10% and 18000 ac-ft/month

Note: Water year 1981 starts Oct/1980 and ends Sep/1981

For Planning Purposes Only
 Run date: 04/12/06 15:27:12
 SFWMM V5.5.2
 Script used: freq_water_restr.scr, V1.11
 Filename: losa_freq_restr.alt2b.fig