


# Frequency of Water Restrictions for the 1965 – 2000 Simulation Period

## Lake Okeechobee Service Area – alt1b

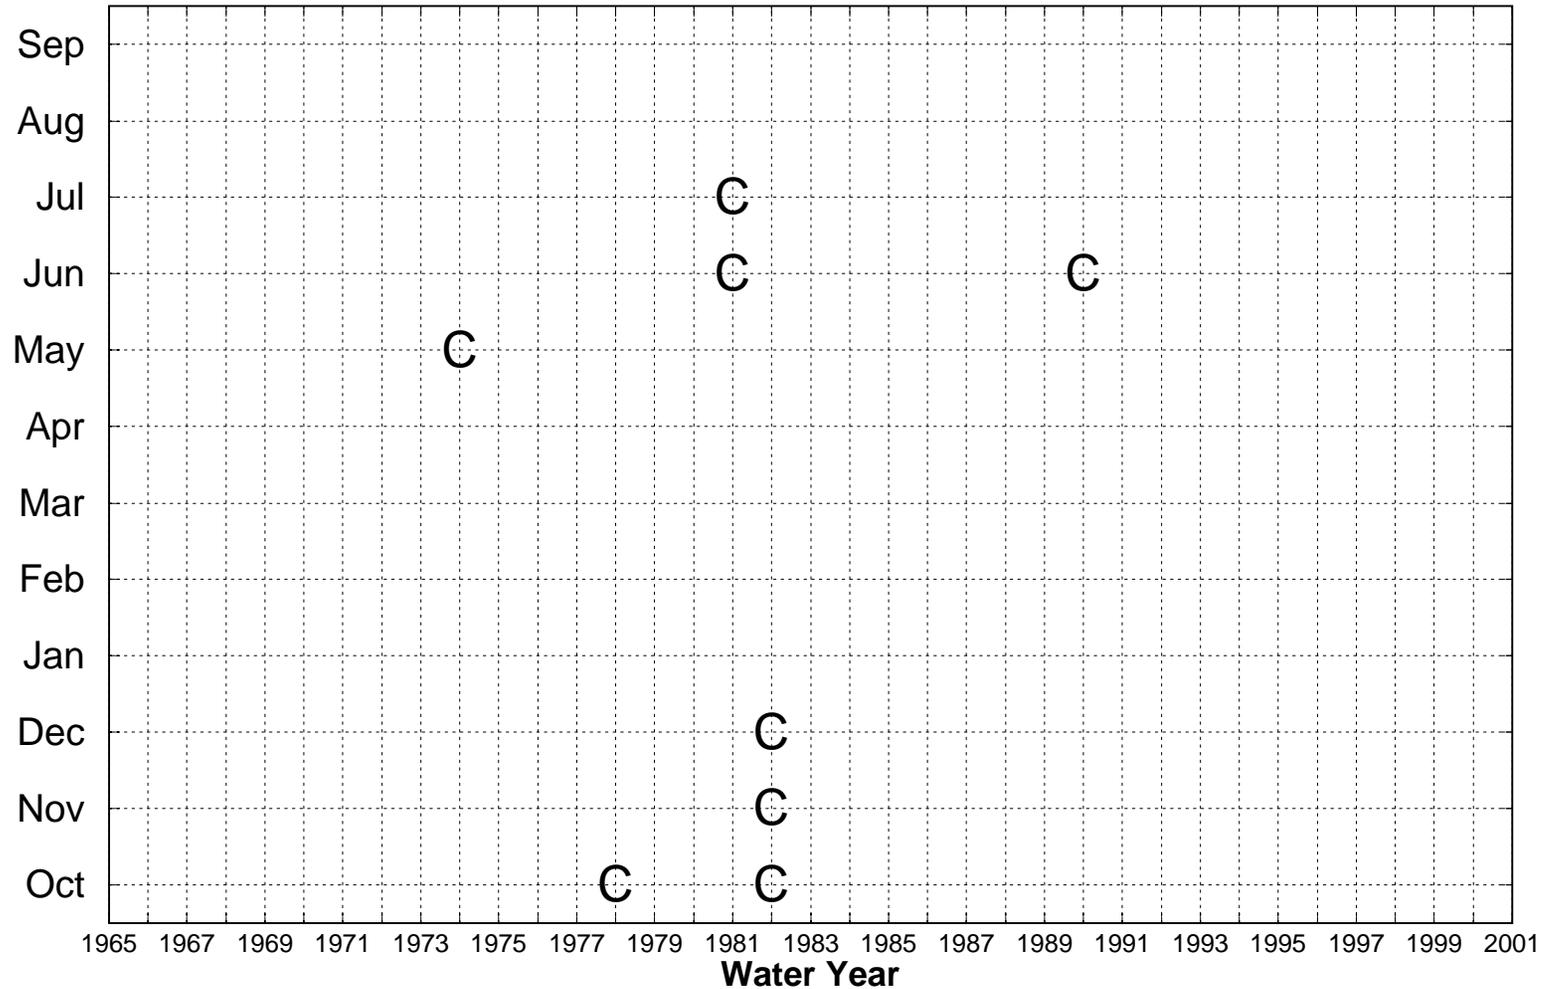

**Total number of water years with restrictions** 5

**Target number of water years with restrictions** 5

**C:** Under Supply Side Management and Cutbacks for 7 days or more, and Cutbacks greater or equal than 10% and 18000 ac-ft/month

Note: Water year 1981 starts Oct/1980 and ends Sep/1981

For Planning Purposes Only  
 Run date: 04/10/06 00:59:08  
 SFWMM V5.5.2  
 Script used: freq\_water\_restr.scr, V1.11  
 Filename: losa\_freq\_restr.alt1b.fig